



NEW MANGALORE PORT AUTHORITY

Mechanical Engineering Department

Panambur, Mangalore - 575 010

Phone: 0824 - 2887730 / 701

No. 20/114/2022-23/EE(M)III-TS(OTM)

Date: 15/02/2023

To,
The Prospective Bidders,

Sir,

Sub : NMPA- Mech. Div. - Supply of SS 316 Jumbo Water Curtain Nozzles with Coupling (Adapter) - Budgetary Quotations - Requested - Reg.

Budgetary Quotations are invited for "Supply of SS 316 Jumbo Water Curtain Nozzles with Coupling (Adapter)" as per BOQ and Terms & Conditions detailed below.

Sl. No.	Description of item	Qty.	Unit	Rate in Rs.	Amount in Rs.
1	Supply of SS316 Coupling (Adapter) for Jumbo Water Curtain Nozzles as per Annexure -1.	28	No.		
2	Supply of SS316 Jumbo Water Curtain Nozzles of 362 LPM (Liters per minute) discharge @7 Kg/cm ² pressure as per Annexure -1. Note: The Projectile Curve of Jumbo Water Curtain Nozzles is enclosed as Annexure -2.	28	No.		
Sub Total					
GST @.....%					
Grand Total					

Terms and conditions:

1. The rate quoted shall be firm and final and inclusive of all taxes & duties excluding GST. GST as applicable shall be paid extra. GST shall be quoted separately.
2. The rate quoted should be valid for at least 45 days from the due date of submission of offer.
3. The successful bidder shall supply twenty eight (28) numbers of Jumbo Water Curtain Nozzles with Coupling (Adapter) which shall be able to produce dense water curtain of 20 meters radius through 15° angle in vertical plane with width of spray 5 mtrs. at discharge rate of 362 LPM of sea water at inlet pressure of 7 kg/cm² (max). The Nozzles & Coupling (Adapter) shall be of SS 316 materials and of 1"BSPT thread (M & F) size as per the Technical Data Sheet & Drawing (**Annexure .1**). The Projectile Curve of Jumbo Water Curtain Nozzles is enclosed as **Annexure .2**.
4. The time allowed for supply of SS 316 Jumbo Water Curtain Nozzles with Coupling (Adapter) is 45 days from the date of issue of work order. The supplied items shall be inspected in the works of manufacturer by any one of the following Third Party Inspection (TPI) Agency viz. IR Class System and Solutions Pvt. Ltd., ABS Industrial Verification (Pvt.) Ltd., DNV, Bureau Veritas (I) Pvt. Ltd. and Lloyds Inspection Agency Pvt. Ltd., before dispatch. The TPI Agency shall inspect the manufacturer's certificate of supply items, visual inspection of supply items and witnessing the flow rate of 362 LPM (Liters per minute) and Vertical throw & width of spray at discharge pressure of 7 Kg/cm² at works of the manufacturer as per the Technical Data Sheet & Drawing (**Annexure .1**). The items shall be dispatched only after satisfactory Third Party Inspection and certification by any one of the above TPI Agency. The items shall be supplied to NMPA site with satisfactory TPI certificate issued by TPIA along with manufacturer's certificate of supply items, performance test certificate and guarantee certificate.



5. The materials shall be dispatched to NMPA site, duly covering the transit insurance. Any damage to the items during transportation shall be to contractors account.
6. **LIQUIDATED DAMAGES:** In case of delay in supply of items, Liquidated Damages (L.D) may be levied at the rate of 0.5% of the contract price plus applicable GST per week delay, or part thereof subject to a maximum of 10 percent of the contract price.
7. **Payment Terms:** 90% value of total tax invoice amount will be made within 15 days after the completion of supply of items at NMPA site alongwith satisfactory TPI certificate, manufacturer's certificate of supply items, performance test certificate and guarantee certificate. Balance 10% of the total tax invoice amount will be retained as SECURITY DEPOSIT and will be released without interest after satisfactory completion of Guarantee/Warrantee period of one year from the date of receipt of materials at NMPA site. The defect, if any noticed during the guaranty period shall be rectified by the contractor at free of cost.
8. Statutory taxes as applicable will be deducted while releasing payment.
9. The Budgetary offer enclosed in a sealed cover super scribed as "Supply of SS 316 Jumbo Water Curtain Nozzles with Coupling (Adapter)" should reach to the under signed on or before 01/03/2023 at 15:00 Hrs. to the below mentioned address. Quotation will be opened on the same day at 16.00 Hrs. in the presence of the bidders who wish to be present.

Encl: As above

Address for Communication:


Executive Engineer (M)III,
Administrative Building, 2nd Floor, Room No.234,
New Mangalore Port Authority,
Panambur, Mangalore - 575010.
Mob: 9449700435, Ph: 0824-2887730
Email: krishnamurthy.ds@nmpt.gov.in


15/02/2023
(Krishnamurthy D S)


Executive Engineer (M)



JUMBO WATER CURTAIN NOZZLE AND COUPLING (ADAPTER)

ANNEXURE-1

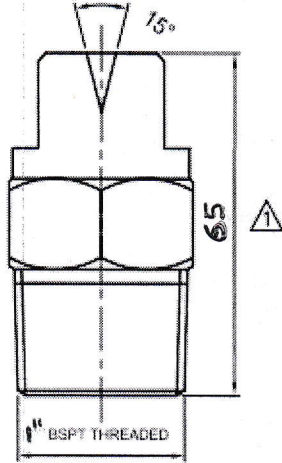


CURTAIN NOZZLE DETAILS

SR NO.	DESCRIPTION	SPECIFICATION
1.	QTY.	28 NOS.
2.	K FACTOR /FLOW	362 LPM
3.	THREAD TYPE	1" BSPT(M)
4.	MATERIAL	SS:316
5.	SPRAY ANGLE COVERAGE	15 DEG
6.	VERTICAL THROW @ 7 BAR	20 MTRS
7.	WIDTH @ 7 BAR OF SPRAY	5 MTRS

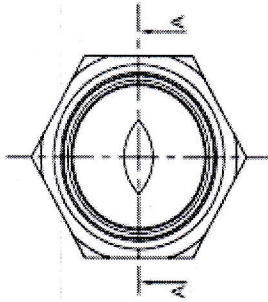

COUPLING (ADAPTER) DETAILS.

SR.NO.	DESCRIPTION	SPECIFICATION
1.	CODE	ANSI.B 16.11
2.	TYPE	HALF COUPLING
3.	THREAD CONNECTION	1" BSPT. (F)
4.	MATERIAL	SS:316
5.	QTY.	28 NOS.




NOTE: ALL DIMENSIONS ARE IN MM
UNLESS OTHERWISE SPECIFIED

[Signature] 15/02/2023
 कार्यपालक अभियंता, (एम) III
 Executive Engineer (M) III
 नव मंगलूर पत्तन प्राधिकरण
 New Mangalore Port Authority
 पणदूर, मंगलूर - ५७५०१०
 Panambur Mangalore - 575 010


ANNEXURE-2

PRESSURE V/S FLOW GRAPH

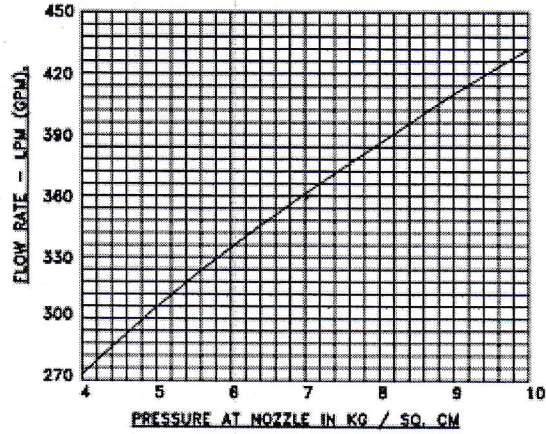


PROJECTILE CURVE OF WATER CURTAIN NOZZLE 362 LPM @ 7 KG/CM²

PRESSURE V/S THROW

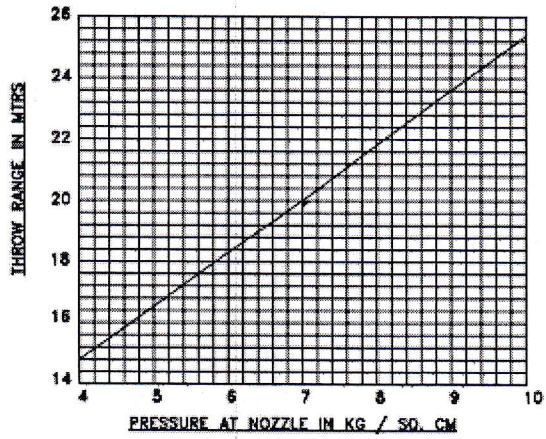

PROJECTILE CURVE OF JUMBO WATER CURTAIN NOZZLES


कार्यपालक अभियंता, (एम) III
Executive Engineer (M) III
नव मंगलूर पत्तन प्राधिकरण
New Mangalore Port Authority
पणवूर, मंगलूर - ५७५०१०
Panambur Mangalore - 575 010

15/07/2023