



नव मंगलूरु पत्तन प्राधिकरण

NEW MANGALORE PORT AUTHORITY

यांत्रिक अभियंता विभाग Mechanical Engineering Department

इलेक्ट्रिकल इंजिनियरिंग डिविजन Electrical Division

Panambur, Mangaluru – 575 010

Phone : 0824 – 2887746 / 39

E-mail: diggavi.b@nmpt.gov.in ele-section@nmpt.gov.in

No. 7/HT-Cable/EE(E)II/2024

Date: 06.11.2024

CORRIGENDUM - I

Sub:- NMPA-EE(E)II - E-Tender for the work “Supply, Laying, Testing and Commissioning of HT 3C x 185 Sq.mm 11KV cable from 33 KV MUSS to A.O. Building & KK Gate Structure – updated Cable Duct Drawing - Corrigendum issued - Reg.

Ref:- Tender No: 7/HT-Cable/EE(E)II/2024, dated: 18/10/2024

With reference to the above E-tender, the following corrigendum has been issued.


Sl.No	Existing	Read as
1	Cable Duct Drawing.	Updated Cable Duct Drawing.

All other terms and conditions mentioned in the tender remain unaltered.

Yours faithfully

-Sd/-

Executive Engineer (Ele)
NMPA Panambur, Mangaluru

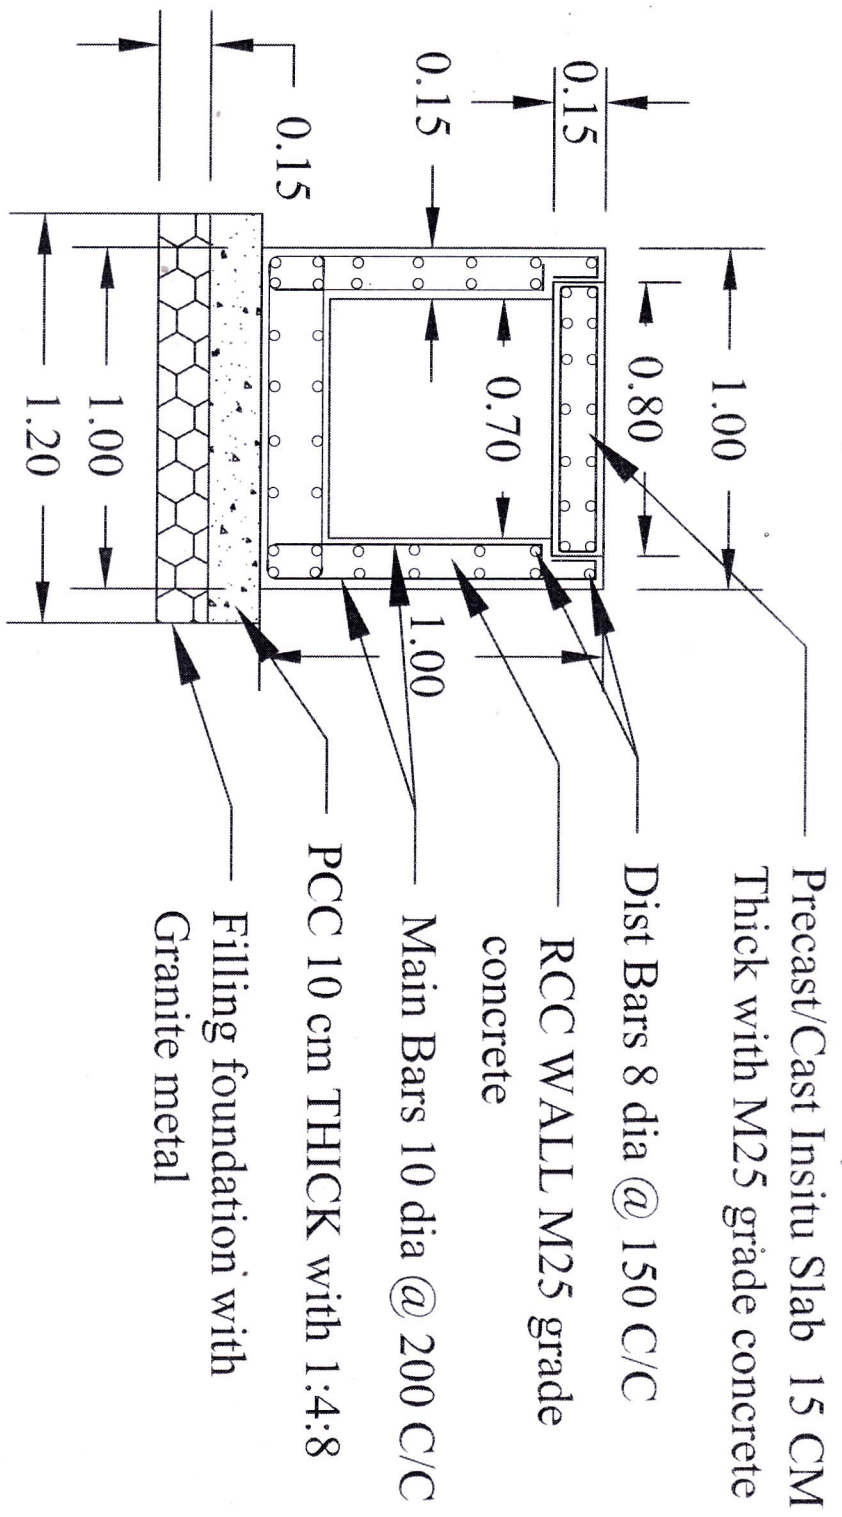

TYPICAL CROSS SECTION OF ELECTRICAL CABLE DUCT [uplabeled]

Note: Tentative drawing not to scale

NEW MANGALORE PORT AUTHORITY	
MECHANICAL ENGINEERING DEPARTMENT	

Handwritten signature and initials in blue ink.